
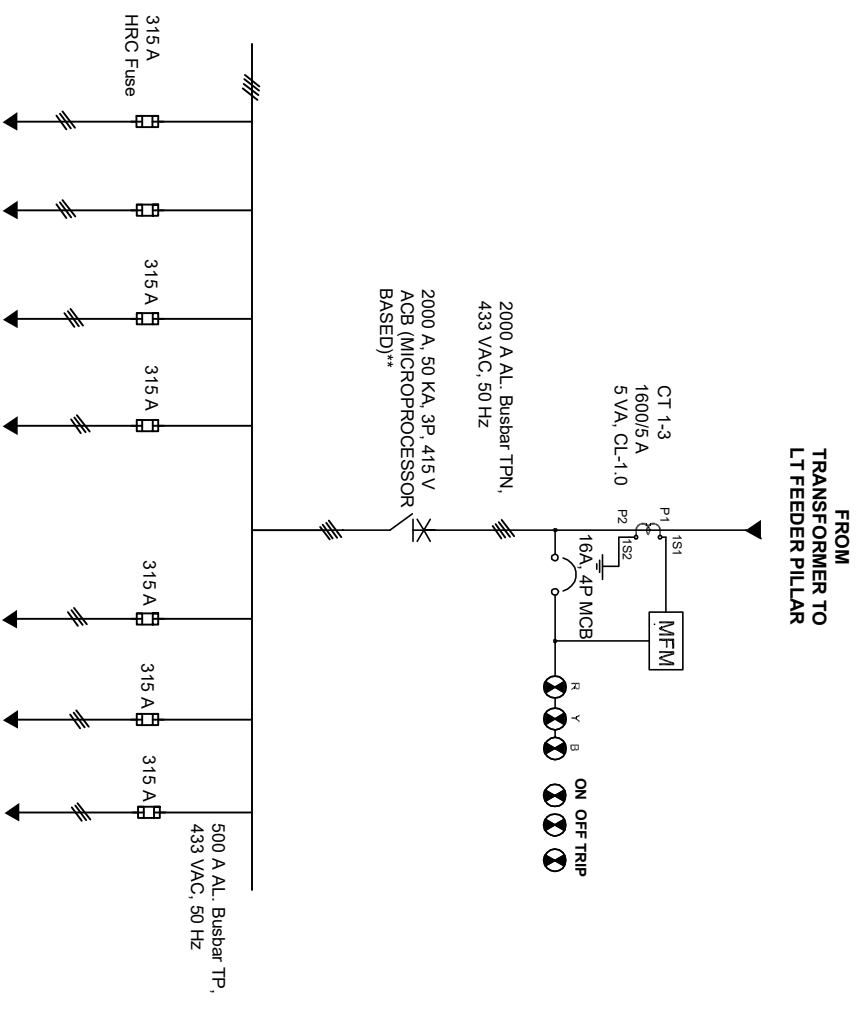


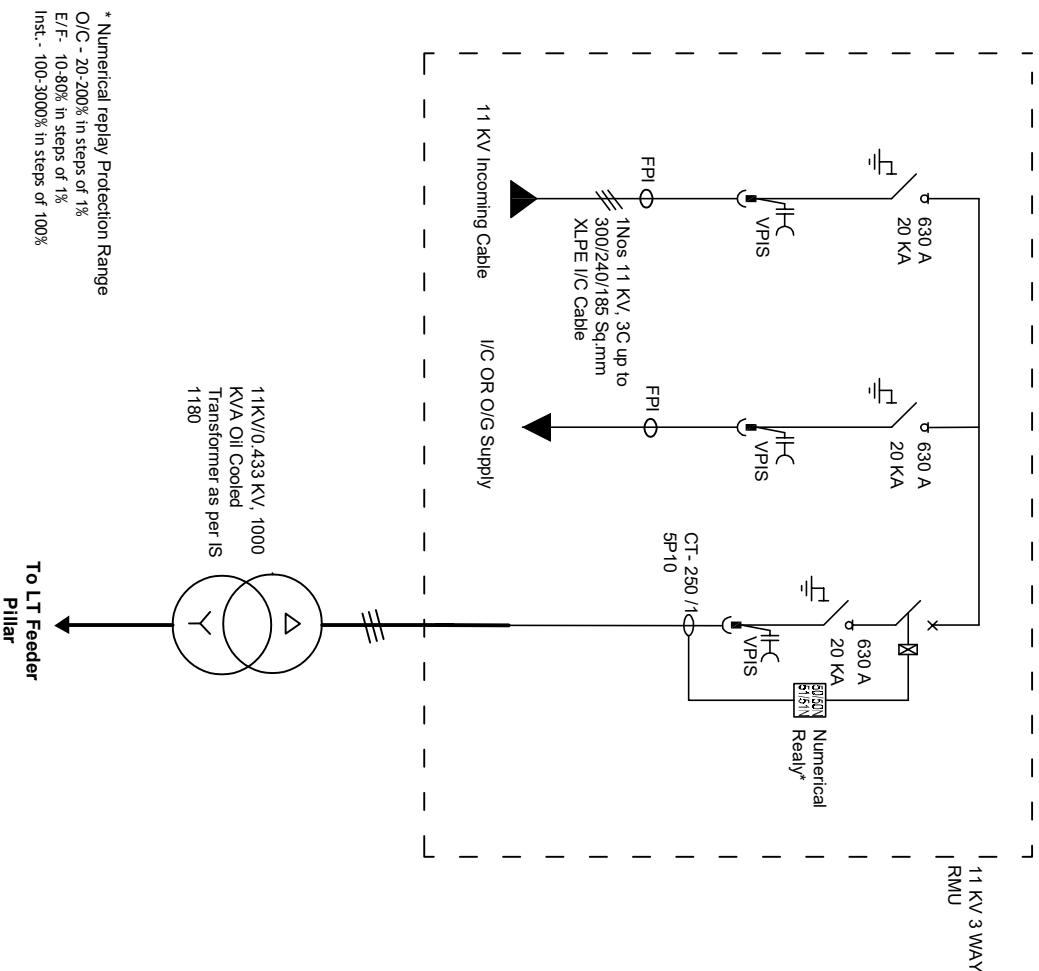

* Numerical replay Protection Range
O/C - 20-200% in steps of 1%
E/F- 10-80% in steps of 1%
Inst.- 100-3000% in steps of 100%

* ACB Protection Range
O/C - 50% -100% of In
E/F- 20-100 % of In
Inst.- 400% - 1500% of In

Note : ANY DISCREPANCY FOUND DRAWINGS SHALL BE REPORTED TO GPRD CELL BEFORE WORK COMMENCES.

HT, LT SWITCHGEAR AND TRANSFORMER TYPE & RATING SHALL BE AS PER CEA SAFETY REGULATION-2023 LATEST AMENDED
REFER LATEST TECHNICAL SPECIFICATIONS AND APPROVED DRAWINGS FOR RELEVANT ITEMS

Project Name:
HIGH RATED DISTRIBUTION TRANSFORMER

Drawing Title:

SLD OF 11/0.433 KV, 1000 KVA arrangement with HT & LT switchgear

Prepared by:
S.P.RATHOD (J.E)

Checked By:
J.H Borisagar (J/C EE)

Approved By:
D.S. Olakiya (SE)

Project No/ Date:

RP 178

Drawing No.:

GPRD/DRG/TR 110

Revision No.:

0

Gujarat Power Research and Development Cell, GUVNL, Research Park, IIT Gandhinagar, Palaj, Gandhinagar, Gujarat

