
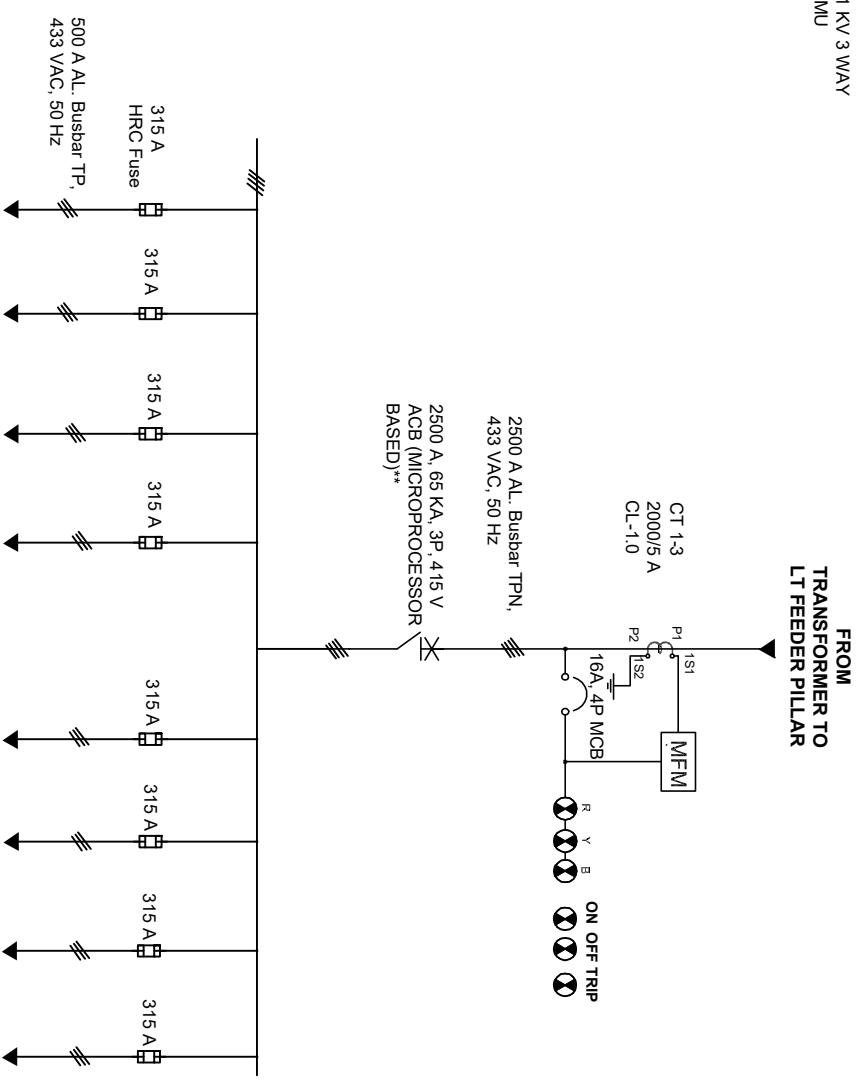


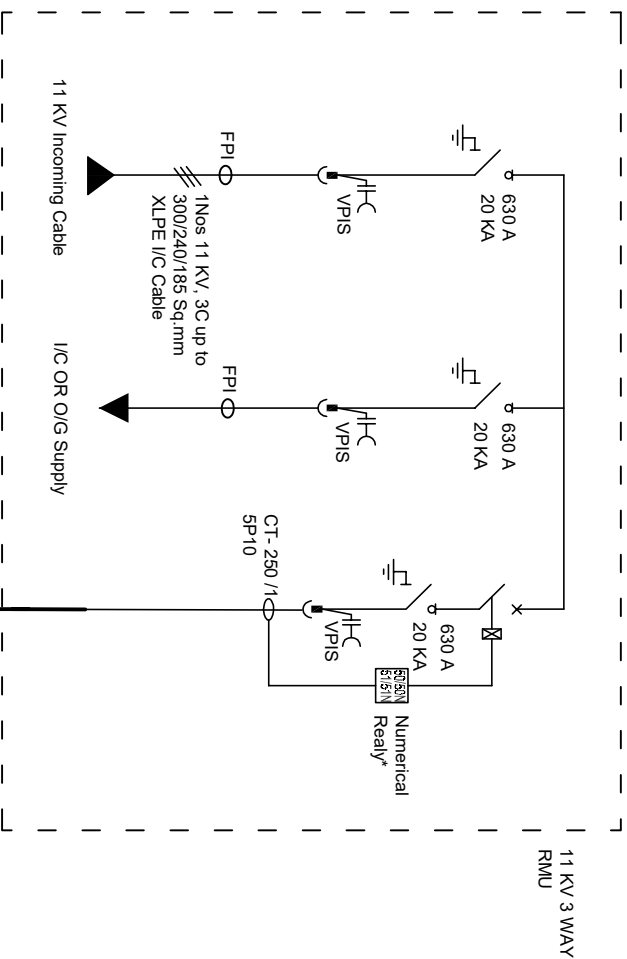

* Numerical replay Protection Range
O/C - 20-200% in steps of 1%
E/F - 10-80% in steps of 1%
Inst. - 100-3000% in steps of 100%

**To LT Feeder
Pillar**

Note : ANY DISCREPANCY FOUND DRAWINGS SHALL BE REPORTED TO GPRD CELL BEFORE WORK COMMENCES.

REFER LATEST TECHNICAL SPECIFICATIONS AND APPROVED DRAWINGS FOR RELEVANT ITEMS

Project Name:

**HIGH RATED DISTRIBUTION
TRANSFORMER**

Drawing Title:

SLD OF 11/0.433 KV, 1250 KVA
arrangement with HT & LT switchgear

Prepared by:
S.P.RATHOD (J.E)

Checked By:

J.H. Borisagar (I/C EE)

Approved By:

D.S. Olakiya (SE)

Project No/ Date:

P 178

Drawing No:

GPRD/DRG/TR/ 111

Revision No :

Gujarat Power Research and Development Cell, GUVNL, Research Park, IIT Gandhinagar, Palaj, Gandhinagar, Gujarat

