
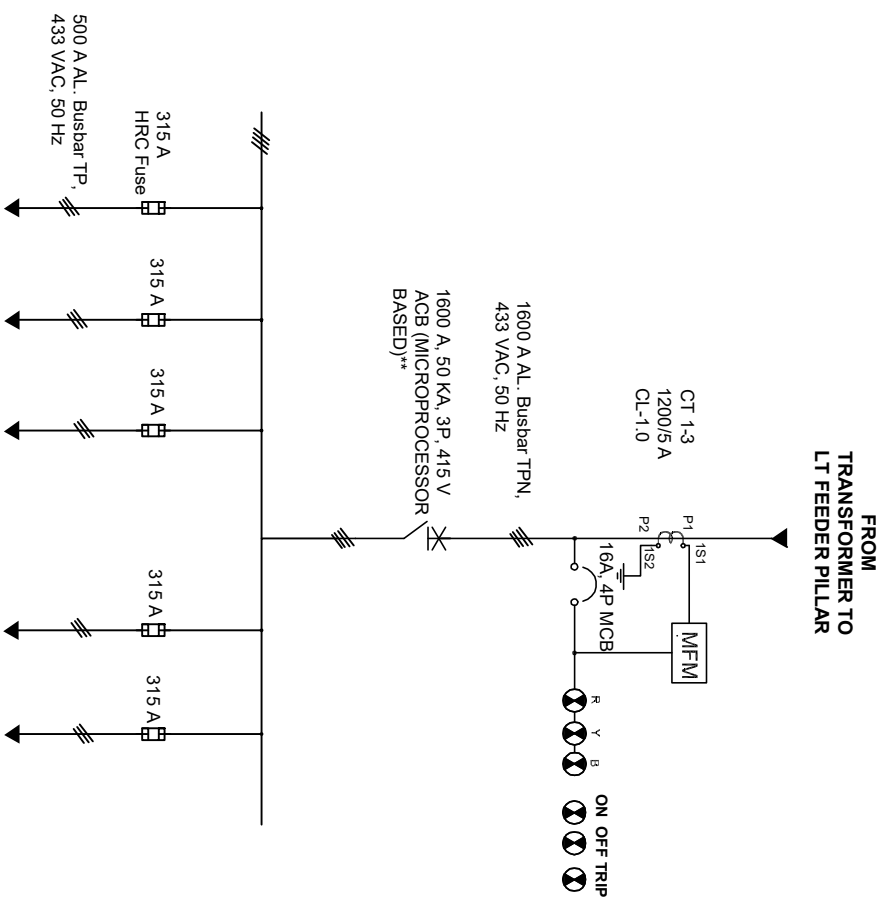


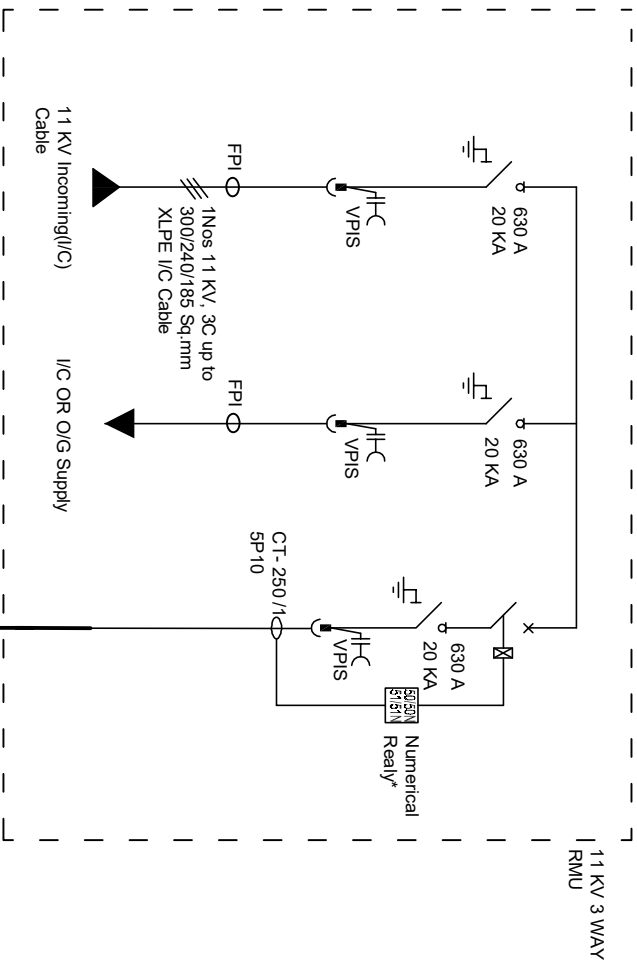

* Numerical replay Protection Range
O/C - 20-200% in steps of 1%
E/F- 10-80% in steps of 1%
Inst. - 100-3000% in steps of 100%

To LT Feeder
Pillar

* ACB Protection Range
O/C - 50% -100% of In
E/F- 20- 100 % of In
Inst. - 400% - 1500% of In

Note : ANY DISCREPANCY FOUND DRAWINGS SHALL BE REPORTED TO GPRD CELL BEFORE WORK COMMENCES.

HT , LT SWITCHGEAR AND TRANSFORMER TYPE & RATING SHALL BE AS PER CEA SAFETY REGULATION-2023 LATEST AMENDED
REFER LATEST TECHNICAL SPECIFICATIONS AND APPROVED DRAWINGS FOR RELEVANT ITEMS

Project Name: HIGH RATED DISTRIBUTION TRANSFORMER		Prepared by: S.P.RATHOD (J.E)		Project No/ Date: RP 178	
Drawing Title: SLD OF 11/0.433 KV, 800 KVA arrangement with HT & LT switchgear		Checked By: J.H Borisagar (I/C EE)		Revision No : 0	
		Approved By: D.S. Olakiya (SE)		GPRD/DRG/TR/ 109	
				Gujarat Power Research and Development Cell, GUVNL, Research Park, IIT Gandhinagar, Palaj, Gandhinagar, Gujarat	

