
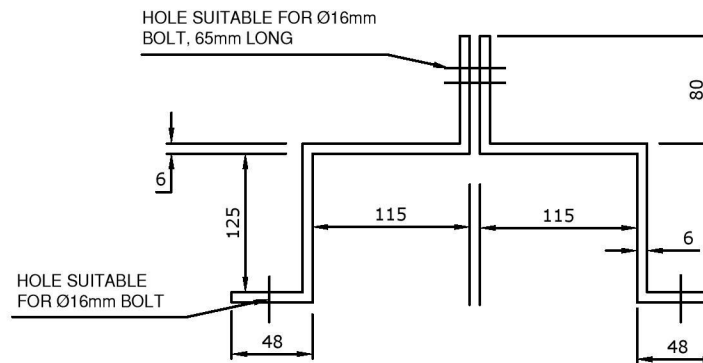
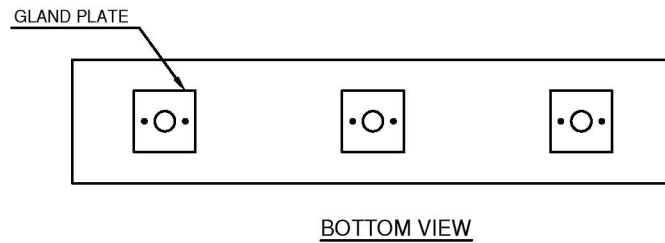
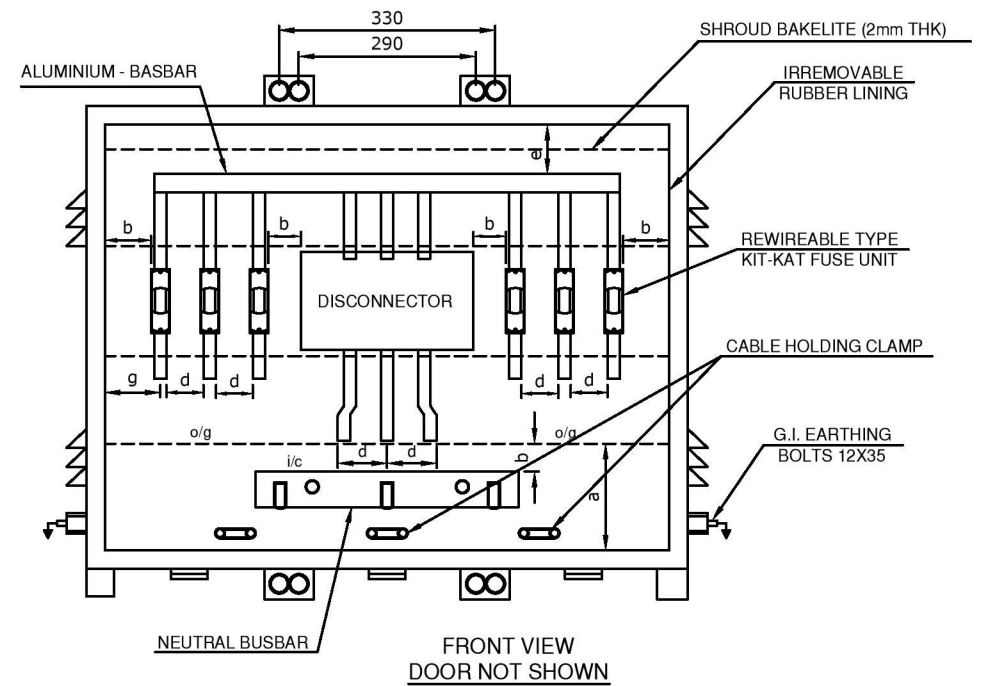
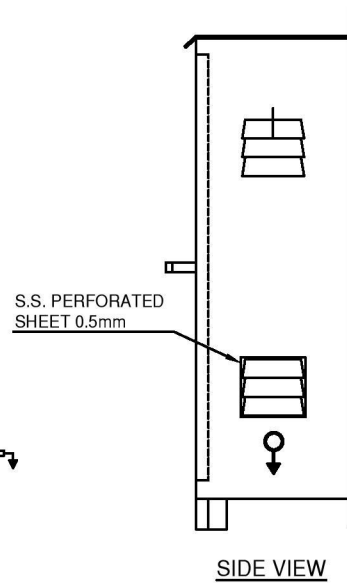


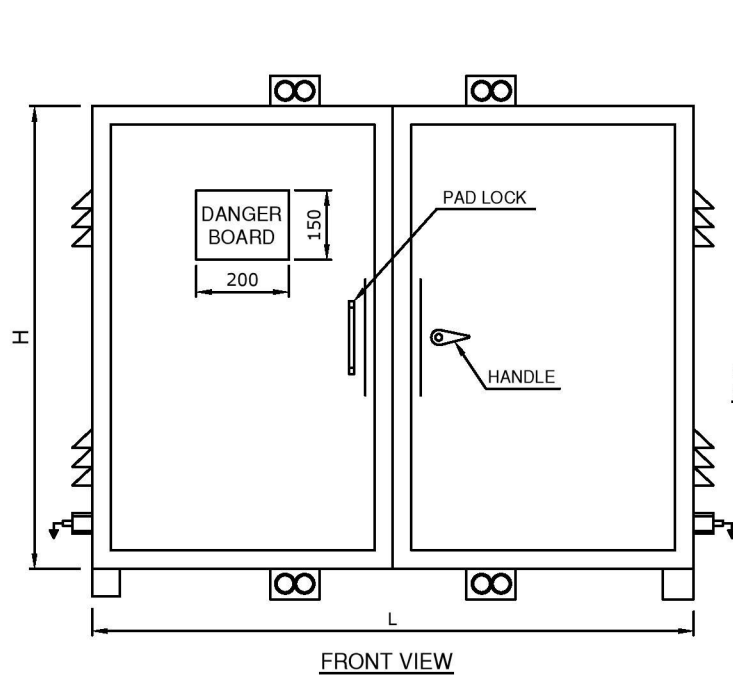

NOTES:
ENCLOSURE SHEET THICKNESS NOT LESS THAN 1.6mm SUITABLE INSULATING SHROUDS SHALL BE PROVIDED ALL BUSBAR COVERED WITH HEAT SHRINKABLE SLEEVE ENCLOSURE IS DUST AND VERMIN PROOF SUITABLE FOR IP-44 GENERAL TOLERANCE ON DIMENSION ($\pm$)3%.

RATING	ALU-BUS BAR SIZE in mm		DIMENSIONS IN mm			CURRENT DENSITY
	MAIN BUS	NEUTRAL BUS	L	B	H	
25KVA	25 X 3	25 X 3	975	275	825	NOT MORE THEN 1.4 A/mm ²
63KVA	25 X 6	25 X 6	975	275	825	
100KVA	25 X 6	25 X 6	1025	275	825	

MIN. CLEARANCES

a = 325mm
b = 75mm
c = 35mm
d = 75mm
e = 75mm
g $\geq$ b

This is Schematic Drawing

TITLE:	SCALE:	APPROVED BY:
GENERAL ARRANGEMENT DRAWING FOR 25 KVA / 63 KVA/ 100 KVA DISTRIBUTION BOX WITH DISCONNECTOR SWITCH AND KIT KAT FUSE	NTS All Dimensions Are In MM.	
MADHYA GUJARAT VIJ COMPANY LIMITED		
DRG NO.: 1 - (LTDB)		